
LOAD MANAGEMENT

Pictured are examples of what Barron Electric's load management receivers typically look like. The receiver has a small window with LED lights, refer to the key below for details. Depending on installation circumstances, the positioning of your lights may vary.

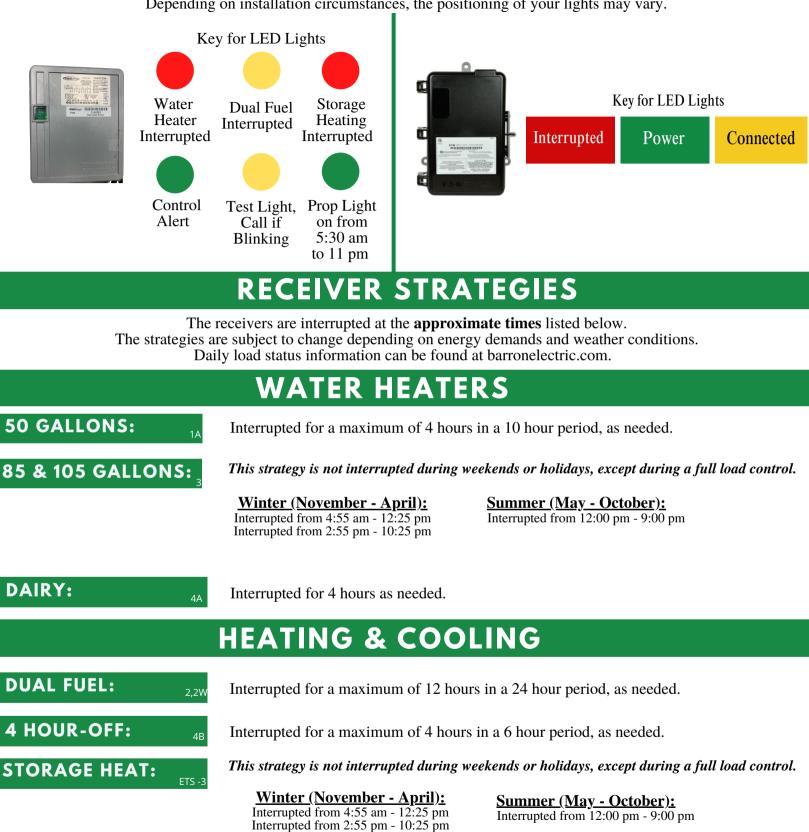

CENTRAL AIR:

2, 2S

Air conditioner is cycled, to run 15 minutes on and 15 minutes off, during peak times.

ELECTRIC VEHICLES

This strategy is not interrupted during weekends or holidays, except during a full load control. Interrupted from 2:00 pm - 9:00 pm.

